

APPLICATION


For mobile-electrical equipment used in mines, factories, farm or household appliances. This cable is suitable foe use in places where cables come in contrct with oils.

Number	Nominal	Conductor	Insulation	Outer	Overall	Conductor	Insulation	Continuous	Cable	Standard
of	cross	type	thickness	sheath	diameter	resistance	resistance	current	weight	Length
core	sectional		nominal	thickness	maximum	at 20°C	at 70°C	rating in free air at	approx.	
	area			nominal		maximum	minimum	40°C		
								maximum		
								(A)		
	(mm ²)		(mm)	(mm)	(mm)	(Ω/km)	(MΩ-km)	X	(kg/km)	(m)
1	4	Flexible	0.9	1.4	8.6	4.95	0.0084	30	90	100/C
	6	Flexible	0.9	1.4	9.4	3.30	0.0071	39	120	100/C
	10	Flexible	1.1	1.8	12.0	1.91	0.0068	51	210	100/C
	26	Flexible	1.1	1.8	13.5	1.21	0.0050	73	270	100/C
	25	Flexible	1.3	2.2	16.0	0.780	0.0048	97	410	100/C
	35	Flexible	1.3	2.2	17.5	0.554	0.0041	140	550	500/D
2	4	Flexible	0.9	1.6	14.5	4.95	0.0084	30	230	100/C
	6	Flexible	0.9	1.6	16.0	3.30	0.0071	39	320	100/C
	10	Flexible	1.1	1.8	20.0	1.91	0.0068	51	500	500/D
	26	Flexible	1.1	2.2	23.0	1.21	0.0050	73	700	500/D
	25	Flexible	1.3	2.4	27.5	0.780	0.0048	97	1000	500/D
	35	Flexible	1.3	2.6	31.0	0.554	0.0041	140	1400	500/D
3	4	Flexible	0.9	1.6	15.5	4.95	0.0084	26	280	100/C
	6	Flexible	0.9	1.8	17.5	3.30	0.0071	34	390	100/C
	10	Flexible	1.1	2.0	21.5	1.91	0.0068	47	650	500/D
	26	Flexible	1.1	2.4	25.0	1.21	0.0050	63	900	500/D
	25	Flexible	1.3	2.6	30.0	0.780	0.0048	83	1300	500/D
	35	Flexible	1.3	2.8	33.5	0.554	0.0041	102	1700	500/D
4	4	Flexible	0.9	1.8	17.0	4.95	0.0084	26	350	100/C
	6	Flexible	0.9	2.0	19.5	3.30	0.0071	34	490	100/C
	10	Flexible	1.1	2.2	24.0	1.91	0.0068	47	800	500/D
	26	Flexible Flexible	1.1	2.6	28.0 33.0	1.21 0.780	0.0050 0.0048	63 83	1100 1700	500/D 500/D
	25 35	Flexible	1.3 1.3	2.8 3.1	33.0	0.780	0.0048	102	2200	500/D
		I IEVIDIG	1.5	5.1	51.0	0.004	0.0041	102	2200	- 300/D

B

C = Packing in coil

D = Packing in drum

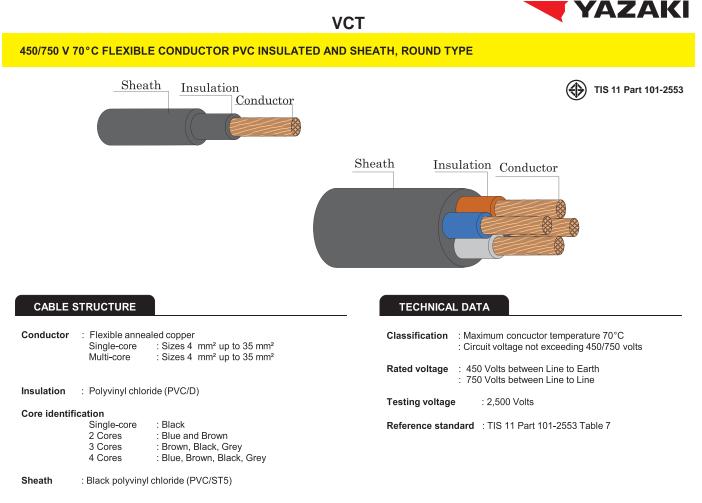

APPLICATION

For mobile-electrical equipment used in mines, factories, farm or household appliances. This cable is suitable foe use in places where cables come in contrct with oils.

Number	Nominal	A.C.Resistance	Inductance	Reactance	Impedance	
of	cross	R	L	XL	Z	
core	sectional					
	area					
	(mm ²)	(Ω/km)	(mH/km)	(Ω/km)	(Ω/km)	
	4	5.9227	0.5946	0.1868	5.9256	
	6	3.9485	0.5605	0.1761	3.9524	
1	10	2.2854	0.5529	0.1737	2.2919	
I	16	1.4478	0.5306	0.1667	1.4574	
	25	0.9334	0.5275	0.1657	0.9480	
	35	0.6630	0.5086	0.1598	0.6820	
	4	5.9227	0.3084	0.0969	5.9235	
	6	3.9485	0.2862	0.0899	3.9495	
0	10	2.2854	0.2768	0.0870	2.2870	
2	16	1.4479	0.2638	0.0829	1.4502	
	25	0.9334	0.2602	0.0817	0.9370	
	35	0.6631	0.2500	0.0785	0.6677	
	4	5.9227	0.3084	0.0969	5.9235	
	6	3.9485	0.2862	0.0899	3.9495	
0	10	2.2854	0.2768	0.0870	2.2870	
3	16	1.4479	0.2638	0.0829	1.4503	
	25	0.9335	0.2602	0.0817	0.9371	
	35	0.6632	0.2500	0.0785	0.6678	
	4	5.9227	0.3084	0.0969	5.9235	
	6	3.9485	0.2862	0.0899	3.9495	
4	10	2.2854	0.2768	0.0870	2.2870	
7	16	1.4479	0.2638	0.0829	1.4503	
	25	0.9335	0.2602	0.0817	0.9371	
	35	0.6632	0.2500	0.0785	0.6678	